


# Well W#35076 Information

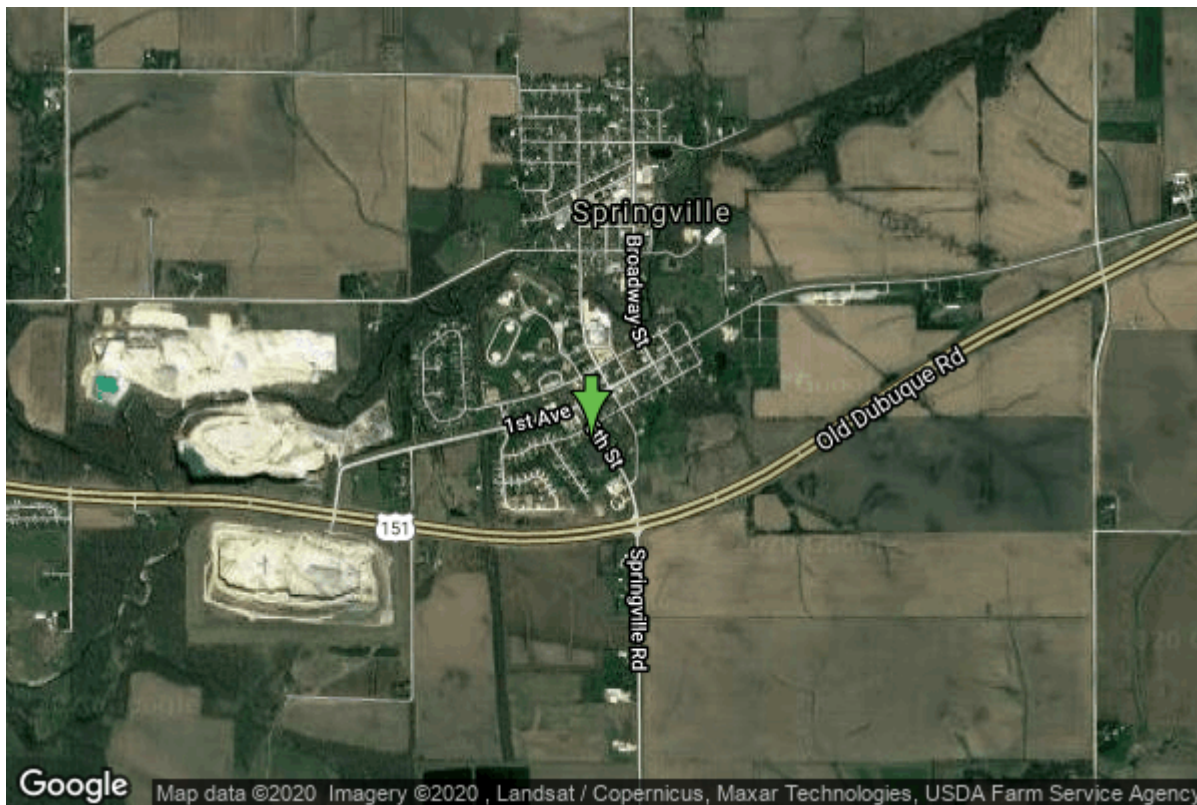

<b>Date Received</b>		<b>State</b>	Iowa
<b>Owner Name</b>	Springville, City Of	<b>County</b>	Linn
<b>Alt Name</b>	CATHOLIC CHURCH WELL	<b>Quadrangle</b>	Springville, Iowa
<b>WNumber</b>	35076	<b>Township</b>	T84N
<b>PWTS ID</b>	0	<b>Range</b>	R5W
<b>PWS ID</b>	5782087	<b>Section</b>	29
<b>Storet ID</b>	0	<b>Quarter</b>	SE SE NE
<b>SDWIS ID</b>	2412997	<b>Latitude</b>	42.0520900000
<b>USGS ID</b>	0	<b>Longitude</b>	-91.4446000000
<b>Project</b>	Source Water Protection	<b>Accuracy</b>	
<b>Operator</b>	Unknown	<b>UTM X</b>	628711
		<b>UTM Y</b>	4656730

<b>Site Type</b>	Drilled hole	<b>Drilling Company</b>	Unknown
<b>Well Status</b>	Active	<b>Drilling Date</b>	01/01/1962
<b>Field Located</b>	No	<b>Drilling Method</b>	Unknown
<b>Elevation</b>	884 ft	<b>Bedrock Depth</b>	0 ft
<b>Elevation Accuracy</b>	Digital Elevation Model Accurate to 5 ft	<b>Well Depth</b>	475 ft
<b>Landscape Position</b>	Unknown	<b>Total Depth</b>	0 ft
		<b>Well Types</b>	Municipal, Public Supply
		<b>Aquifers</b>	Silurian

## Log Information

<b>Date</b>	
<b>Log Types</b>	Drillers log

Prepared By  
Comments

Springville, City Of

## Water Production Information

<b>Date</b>	01/01/1962	<b>Start Time</b>	09:30
<b>Aquifer</b>	Unknown	<b>Yield</b>	260 gallons per minute
<b>Static Water Level</b>	52.00 ft	<b>Yield Method</b>	Unknown
<b>Pumping Water Level</b>	81 ft	<b>Pump Test</b>	Yes
<b>Measurement</b>	Unknown	<b>Duration</b>	0 mins
<b>Pump Method</b>	Unknown		
<b>Comments</b>			

<https://www.ihr.uiowa.edu/igs/geosam/well/35076/general-information>