

W77-586
Dallas Center, 2a

W-38702

7-11-77
Paul H. Cheng

Well #5


ENGINEER: Duane McClelland, P.E.
Anderson Engineering Company

SCOPE: New Well
Including well construction, pump & motor,
and Discharge Piping.

Well Site Approval.

Approved by DEC
Permitting 75' above the original ground surface
H.W.C. = 30' radius berm

WELL LOG & CONSTRUCTION PROFILE

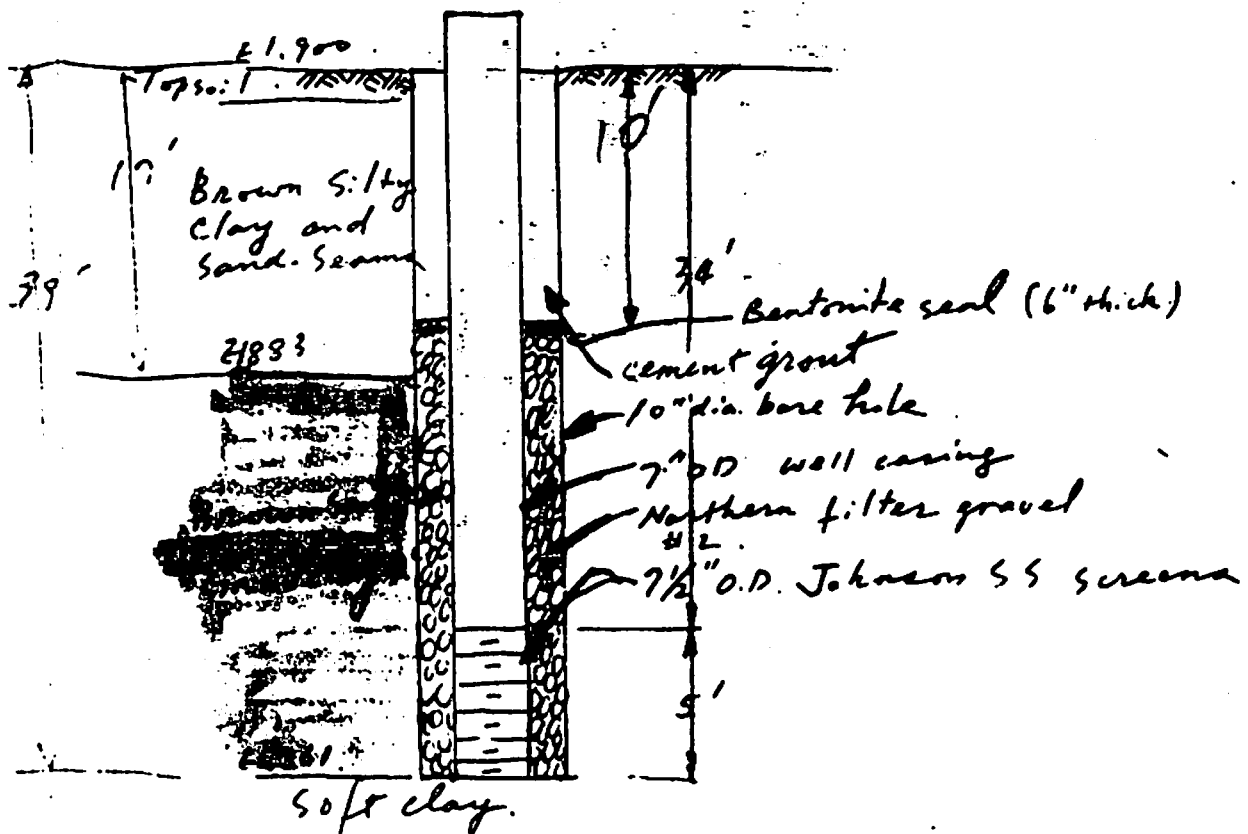

WELL CONSTRUCTION SPECIFICATIONS

Casing Pipe - 7" O.D. steel casing pipe
wt. 23#/ft. thickness .75 inches
Type of joints welded
centering guides

Schedule 40