




Layne-Western Company, Inc.

Subject 1.000N, 1.000W, Well #1

Date 10/7/75

BERM TO HAVE A RADIUS OF 15'.
EARTH BERM SHALL CONSIST OF
CLAY OR LOAM AND SHALL BE
FIRMLY COMPACTED. (BY CITY) SLOPE
3:1

— CASING —
CASING SHALL BE NEW
PRIME STEEL, 16" O.D.,
WITH A WALL THICKNESS
OF .375" LENGTH SHALL
BE 46'.

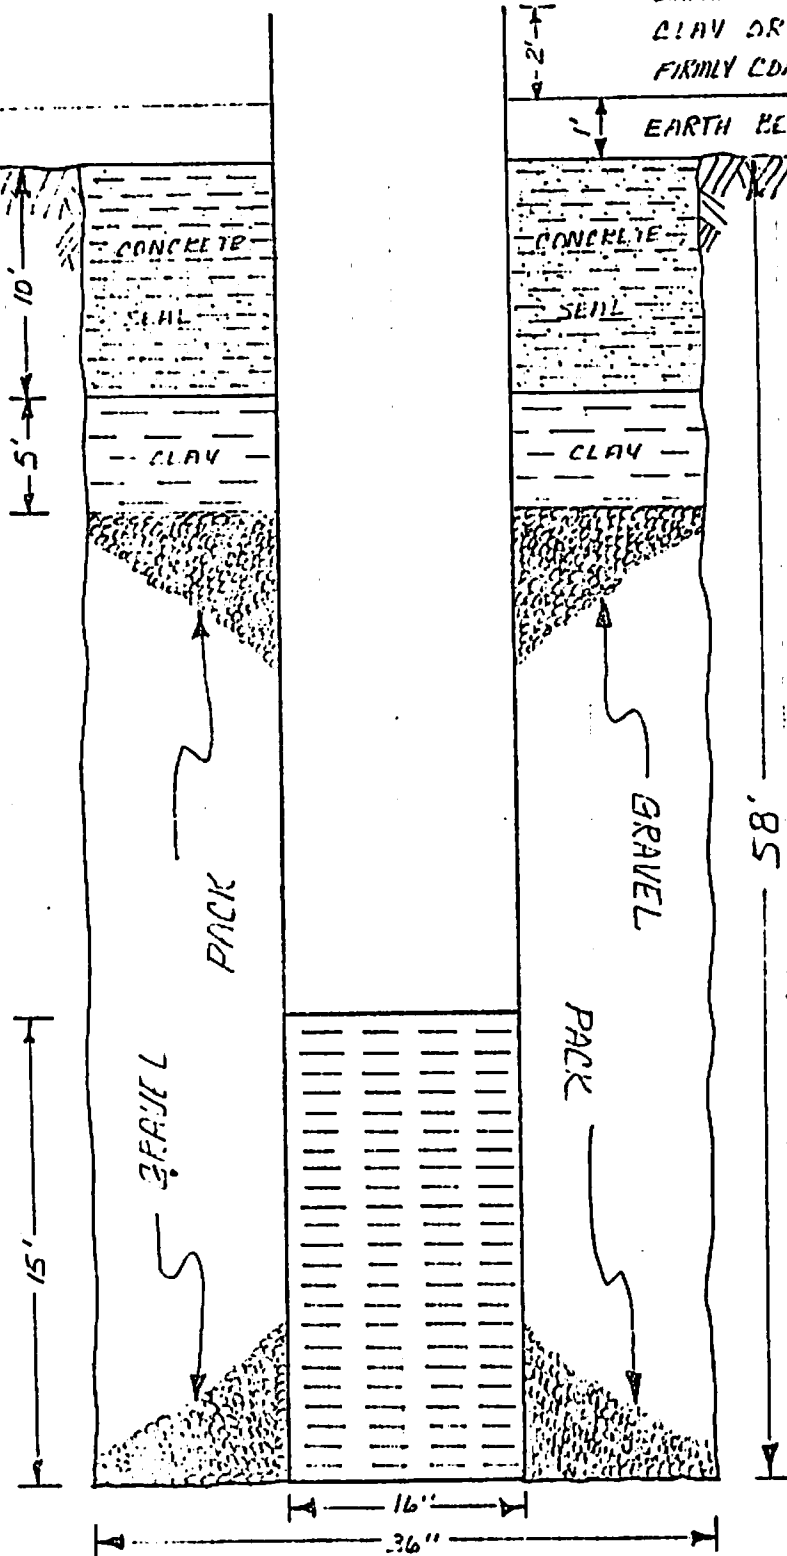

— CLAY SEAL —
CLAY SEAL SHALL
CONSIST OF A MIXTURE
OF CLAY AND 10%
PRAXITE BY WEIGHT

— GRAVEL PACK —
GRAVEL SHALL BE
A SELECTED, WASHED
AND GRADED GRAVEL
SPECIFICALLY SELECTED
TO RETAIN THE NATIVE
SANDS. GRAINS SHALL
BE ROUNDED SILICED
MATERIAL. GRAVEL
WILL BE DISINFECTED
BY MIXING 1 LB OF
HTH PER YARD OF
GRAVEL.

— SCREEN —
SCREEN SHALL BE
LAYNE STAINLESS STEEL
SMALLER SCREEN WITH A
THICKNESS OF .375"
LENGTH SHALL BE 15'.